


NOTES

- 1) All electrical feeders & equipment will be supplied & installed by the customer, meeting requirements set by the local & national electrical code standards. L & L recommends any such installation be approved by a certified electrical inspector.
- 2) For Kilns not equipped with a fused safety disconnect switch, L & L recommends the customer to install such equipment within 6 feet of operating furnace.
- 3) Industrial & commercial applications may require the installation of a LOCKOUT/TAGOUT device to meet safety & maintenance requirements.
- 6) Wire gauge and insulation of Power Wires and Control Circuit Wires are as marked.
- 7) Power Wire Color is Black, and wires are numbered as marked.
- 8) Control Circuit Wires are numbered as marked, and colors are:
RED = 1,3,-6, 8-11.
BLACK = 2.
WHITE = 7,12.
GREEN = GROUNDING AND BONDING WIRES.

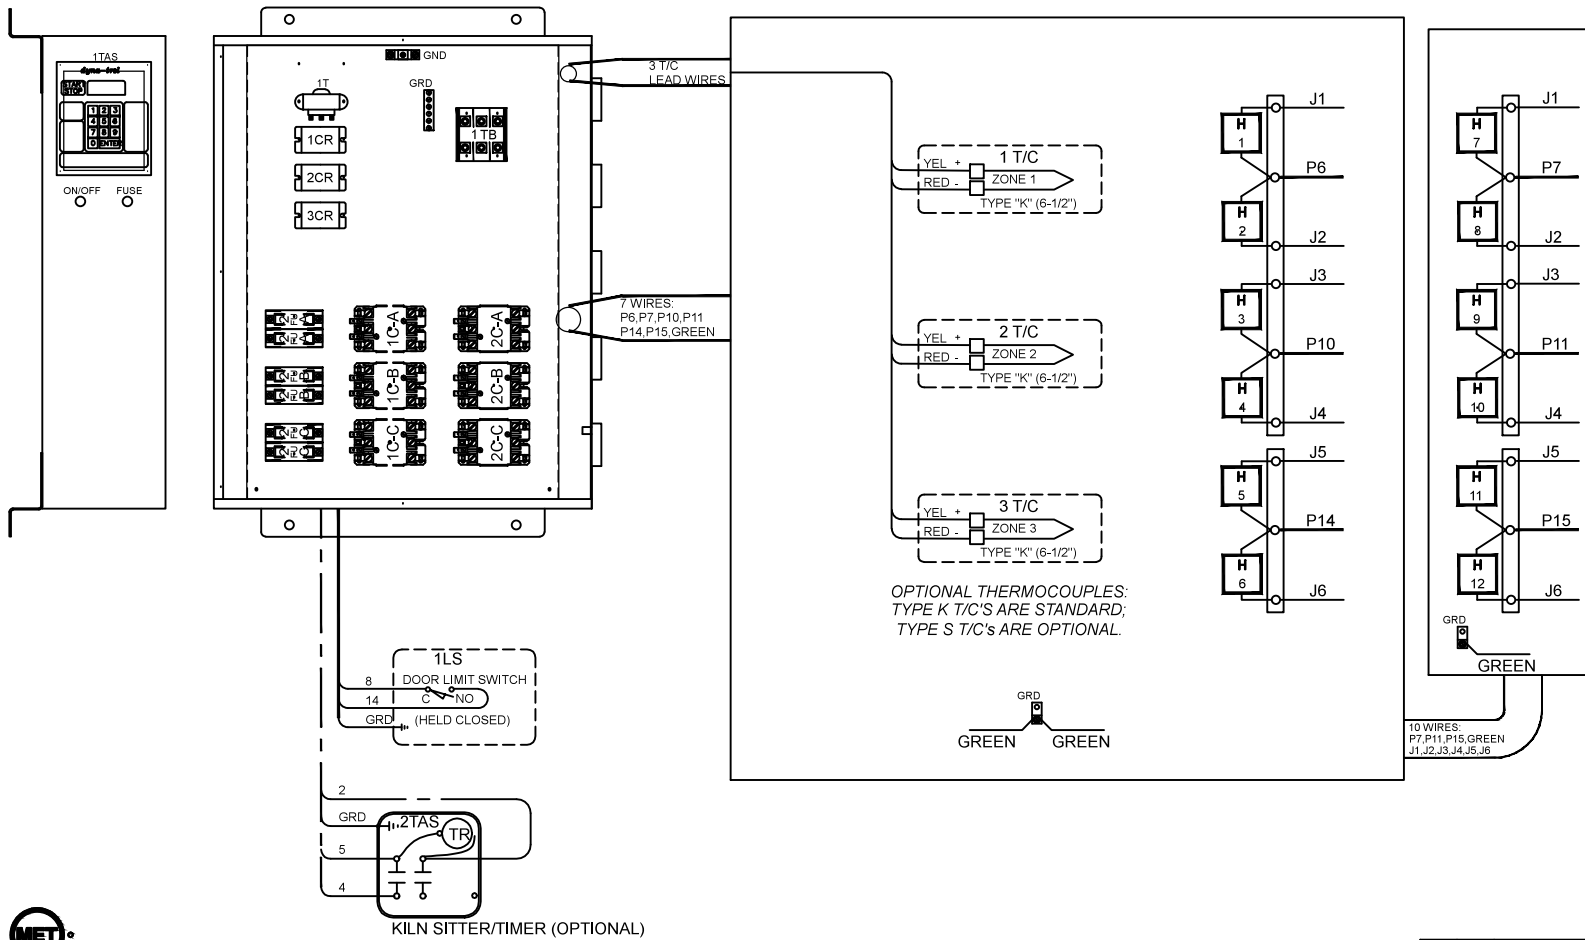

UL 499

DRAWING NO.	SHEET OF	REV	505 SHARPTOWN RD. SWEDESBORO, NJ 08085 PHONE: (856) 294-0077 FAX: (856) 294-0070	TITLE	SCALE	DATE	DRAWN BY	FILE NAME	MADE FROM
350577-	32/2	0		MODEL EL 2427 WIRING DIAGRAM 240 Vac/3/60 - DYNA-TROL	1 = 10	07/25/11	R.P.N.	L:\P\EL\EL2427 350577-32.dwg	350572-32.dwg

REV. #	DATE	REVISION DESCRIPTION
0	7/25/11	ORIGINAL