


# Panel

Note: Dynatrol Control Board (P/N: N-G-D300/00) can be used as a substitute control

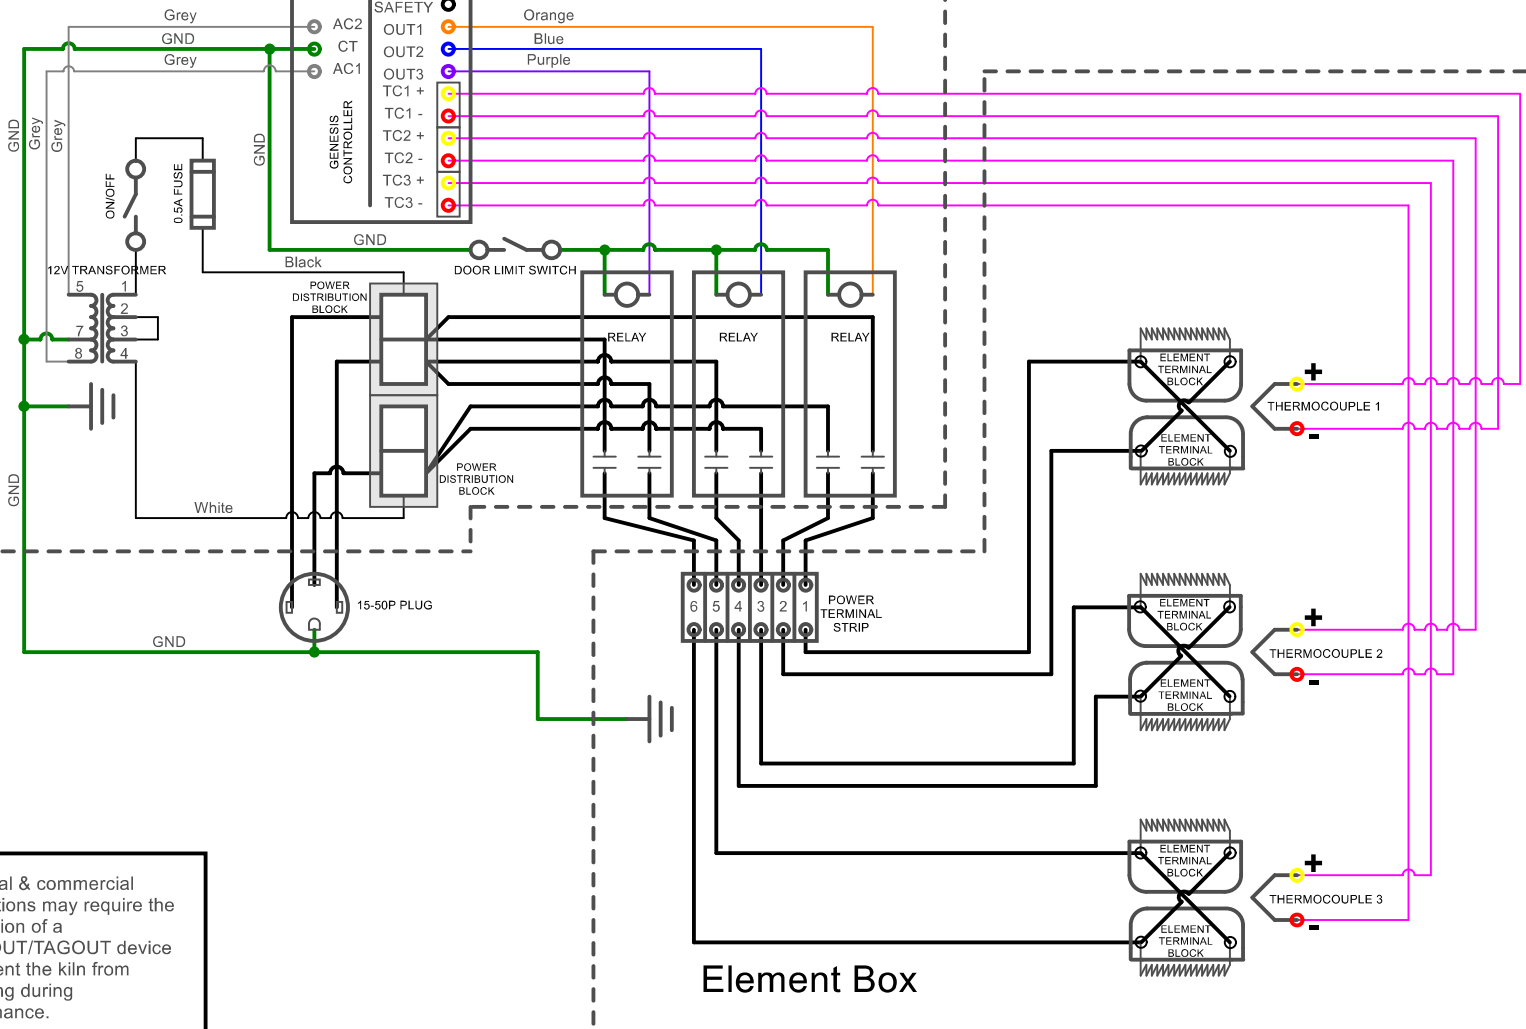

## Element Box

Industrial & commercial applications may require the installation of a LOCKOUT/TAGOUT device to prevent the kiln from operating during maintenance.

This kiln is recommended to be wired & connected to an approved U. L. & NEC configured receptacle controlled with a disconnect switch and properly fused according to the kW load specification listed on the kiln nameplate. L&L Kiln Mfg., Inc., also recommends fuses rather than circuit breakers to prevent nuisance tripping.

### Wiring Information

|                                                                               |                      |
|-------------------------------------------------------------------------------|----------------------|
| Power                                                                         | 10AWG / 150°C / 600V |
| Control                                                                       | 16AWG / 105°C / 600V |
| Power Supply Wire Gauge assumes 75°C Copper Wire. See hotkilns.com/wire-size. |                      |

### Model: eFL1626-208-3P

|                |                         |
|----------------|-------------------------|
| Voltage        | 208 / 3 / 50-60         |
| Watts          | 12,500                  |
| Full Load Amps | L1 34.7 L2 34.7 L3 34.7 |
| Power Supply   | Fuse 50A Wire 8AWG      |
| Elements       | QTY OHMS                |
| E-H-1626/22    | 6 20.0                  |

### Model: eFL1626-240-3P

|                |                         |
|----------------|-------------------------|
| Voltage        | 240 / 3 / 50-60         |
| Watts          | 12,500                  |
| Full Load Amps | L1 30.1 L2 30.1 L3 30.1 |
| Power Supply   | Fuse 40A Wire 8AWG      |
| Elements       | QTY OHMS                |
| E-H-1626/32    | 6 26.6                  |

### eFL1626 3 Phase 208V, 240V



505 Sharptown Road  
Swedesboro NJ 08085  
service@hotkilns.com  
(856)-294-0077

Drawn by: JS

C0077

Rev. Date Description