


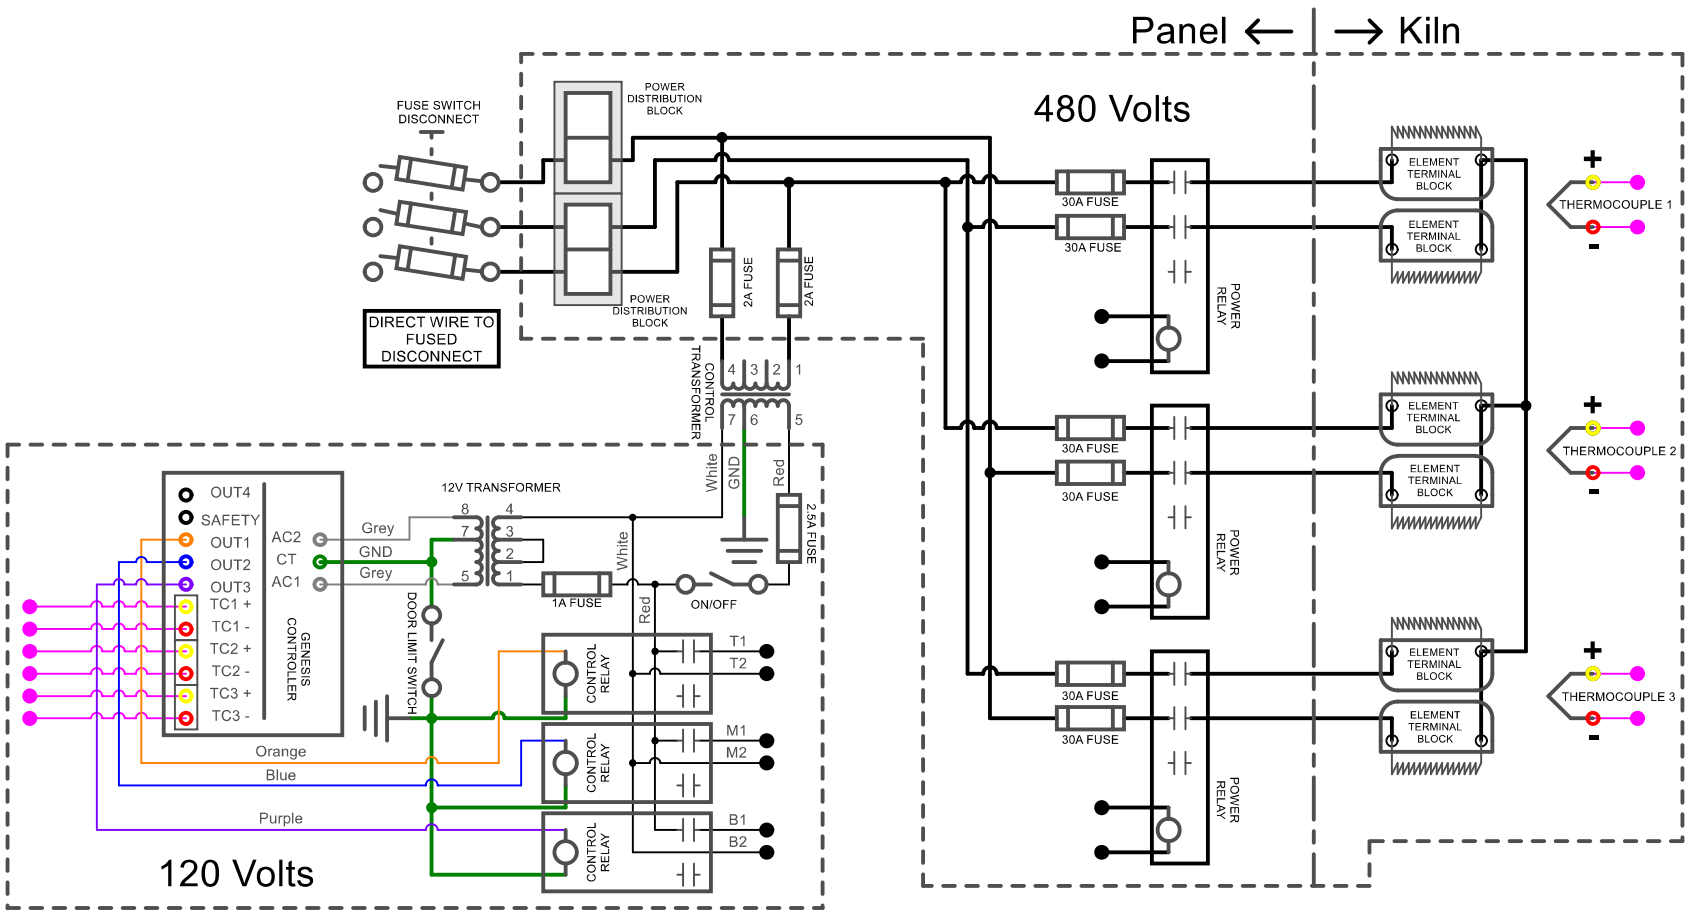

Industrial & commercial applications may require the installation of a LOCKOUT/TAGOUT device to prevent the kiln from operating during maintenance.

This kiln is recommended to be wired & connected to an approved U. L. & NEC configured receptacle controlled with a disconnect switch and properly fused according to the kW load specification listed on the kiln nameplate. L&L Kiln Mfg., Inc., also recommends fuses rather than circuit breakers to prevent nuisance tripping.

WIRE & PLUG NOT INCLUDED
DIRECT WIRE TO
BREAKER PANEL
OR FUSED
DISCONNECT.

Model: eFL2626-480-3P			
Voltage	480 / 3 / 50-60		
Watts	15,360		
Full Load Amps	L1	L2	L3
	18.5	18.5	18.5
Power Supply	Fuse	Wire	
	25A	12AWG	
Elements E-H-2626/60	QTY	OHMS	
	6	28.9	

eFL2626 3 Phase 480V 480V			
Rev.	Date	Description	
			505 Sharptown Road Swedesboro NJ 08085 service@hotkilns.com (856)-294-0077
			Drawn by: JS
			C0079