


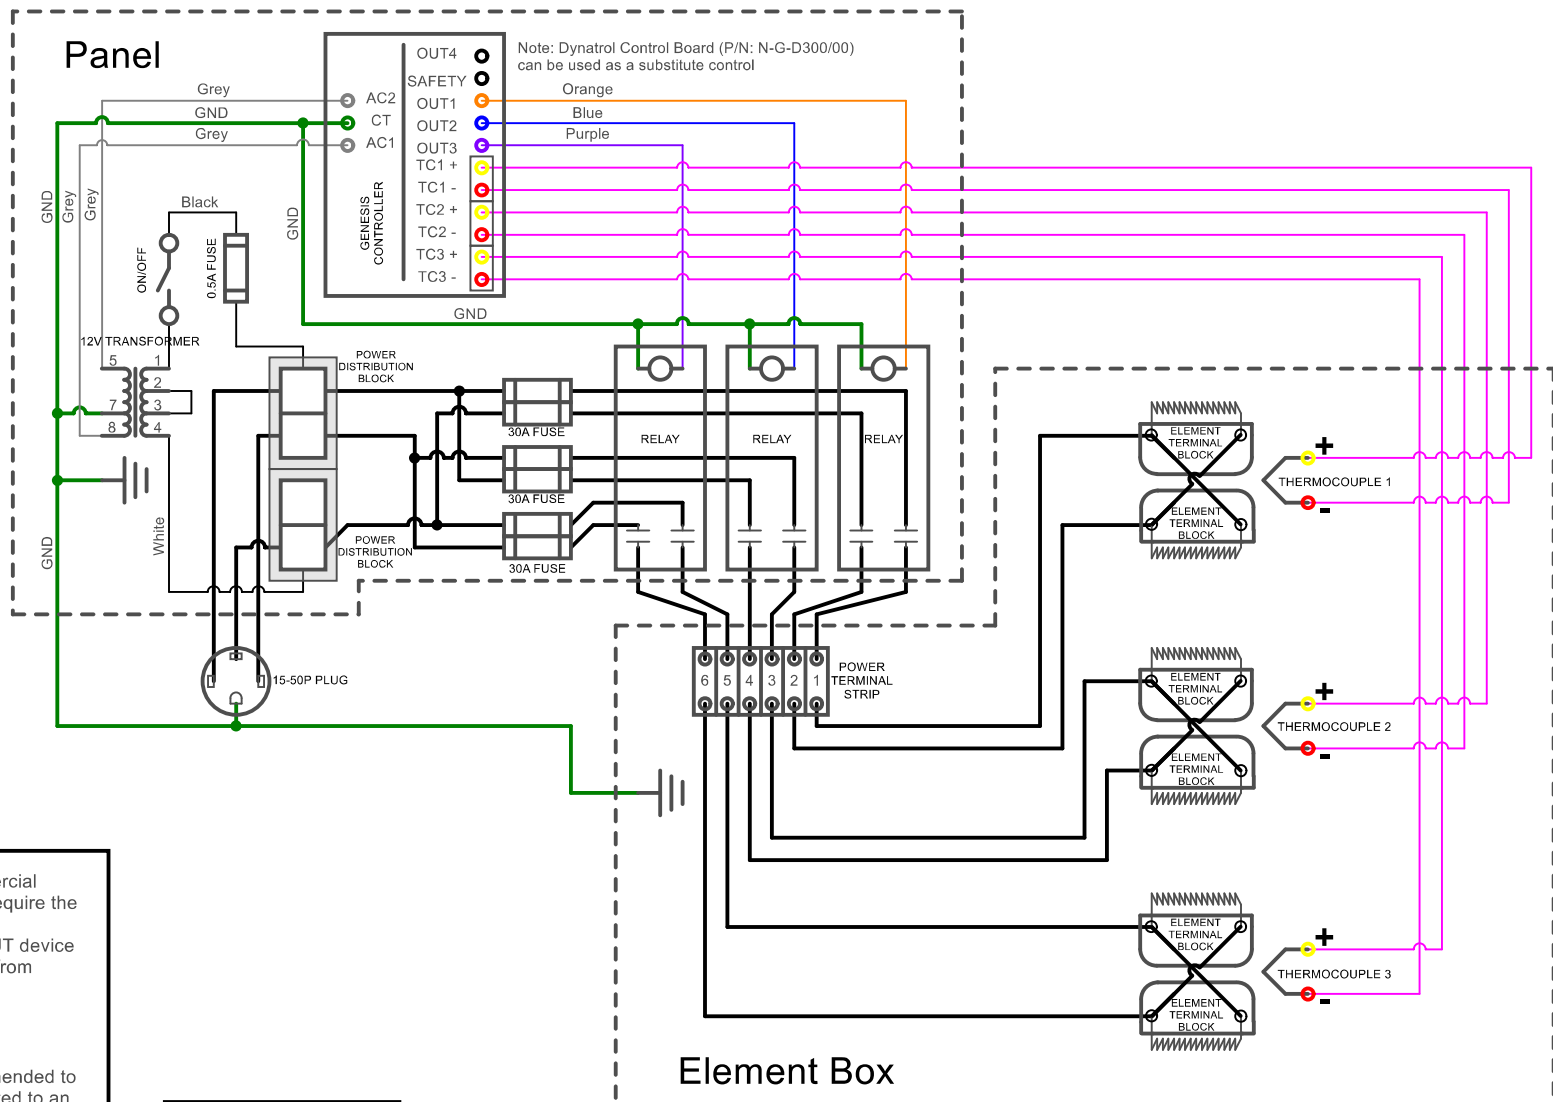

Panel

Note: Dynatrol Control Board (P/N: N-G-D300/00) can be used as a substitute control

- OUT4
- SAFETY
- OUT1
- OUT2
- OUT3
- TC1 +
- TC2 +
- TC3 +
- TC1 -
- TC2 -
- TC3 -

Orange

Blue

Purple

GND

Element Box

Industrial & commercial applications may require the installation of a LOCKOUT/TAGOUT device to prevent the kiln from operating during maintenance.

This kiln is recommended to be wired & connected to an approved U. L. & NEC configured receptacle controlled with a disconnect switch and properly fused according to the kW load specification listed on the kiln nameplate. L&L Kiln Mfg., Inc., also recommends fuses rather than circuit breakers to prevent nuisance tripping.

Wiring Information	
Power	10AWG / 150°C / 600V
Control	16AWG / 105°C / 600V
Power Supply Wire Gauge assumes 75°C Copper Wire. See hotkilns.com/wire-size.	

Model: eQ2327-208-3P			
Voltage	208 / 3 / 50-60		
Watts	11,648		
Full Load Amps	L1	L2	L3
	32.3	32.3	32.3
Power Supply	Fuse	Wire	
	50A	8AWG	
Elements	QTY	OHMS	
E-Q-2327/20	6	21.5	

Model: eQ2327-240-3P			
Voltage	240 / 3 / 50-60		
Watts	13,440		
Full Load Amps	L1	L2	L3
	32.3	32.3	32.3
Power Supply	Fuse	Wire	
	50A	8AWG	
Elements	QTY	OHMS	
E-Q-2327/30	6	24.8	

eQ2327 eQuad-Pro 3 Phase 208V, 240V			 505 Sharptown Road Swedesboro NJ 08085 service@hotkilns.com (856)-294-0077 Drawn by: JS C0088
Rev.	Date	Description	