


Panel

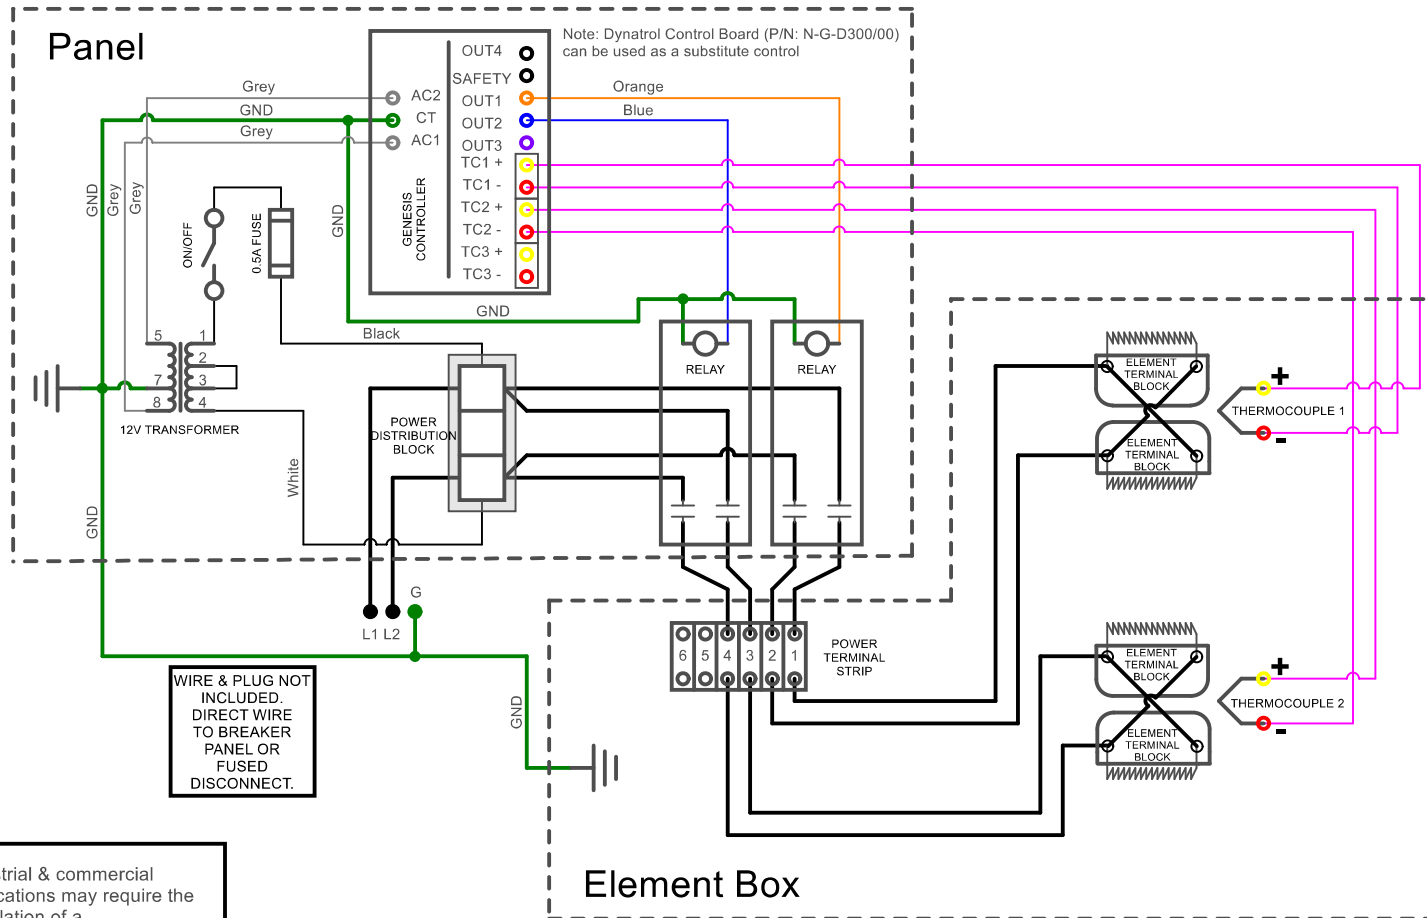

Element Box

Industrial & commercial applications may require the installation of a LOCKOUT/TAGOUT device to prevent the kiln from operating during maintenance.

This kiln is recommended to be wired & connected to an approved U. L. & NEC configured receptacle controlled with a disconnect switch and properly fused according to the kW load specification listed on the kiln nameplate. L&L Kiln Mfg., Inc., also recommends fuses rather than circuit breakers to prevent nuisance tripping.

Wiring Information			
Power	10AWG / 150°C / 600V		
Control	18-22AWG / 105°C / 600V		
Power Supply Wire Gauge assumes 75°C Copper Wire. See hotkilns.com/wire-size.			
Model: e23S-220			
Voltage	220 / 1 / 50-60		
Watts	8,660		
Full Load Amps	L1	L2	L3
	39.4	39.4	
Power Supply	Fuse	Wire	
	50A	8AWG	
Standard Elements: E-E-23SL/41			
Quad Elements: E-E-23SU/41			
Quantity: 4	Ohms: 21.5		

E23S Easy-Fire 1 Phase 220V 220V



505 Sharptown Road
Swedesboro NJ 08085
service@hotkilns.com
(856)-294-0077

Drawn by: JS

C0019

Rev. Date Description