


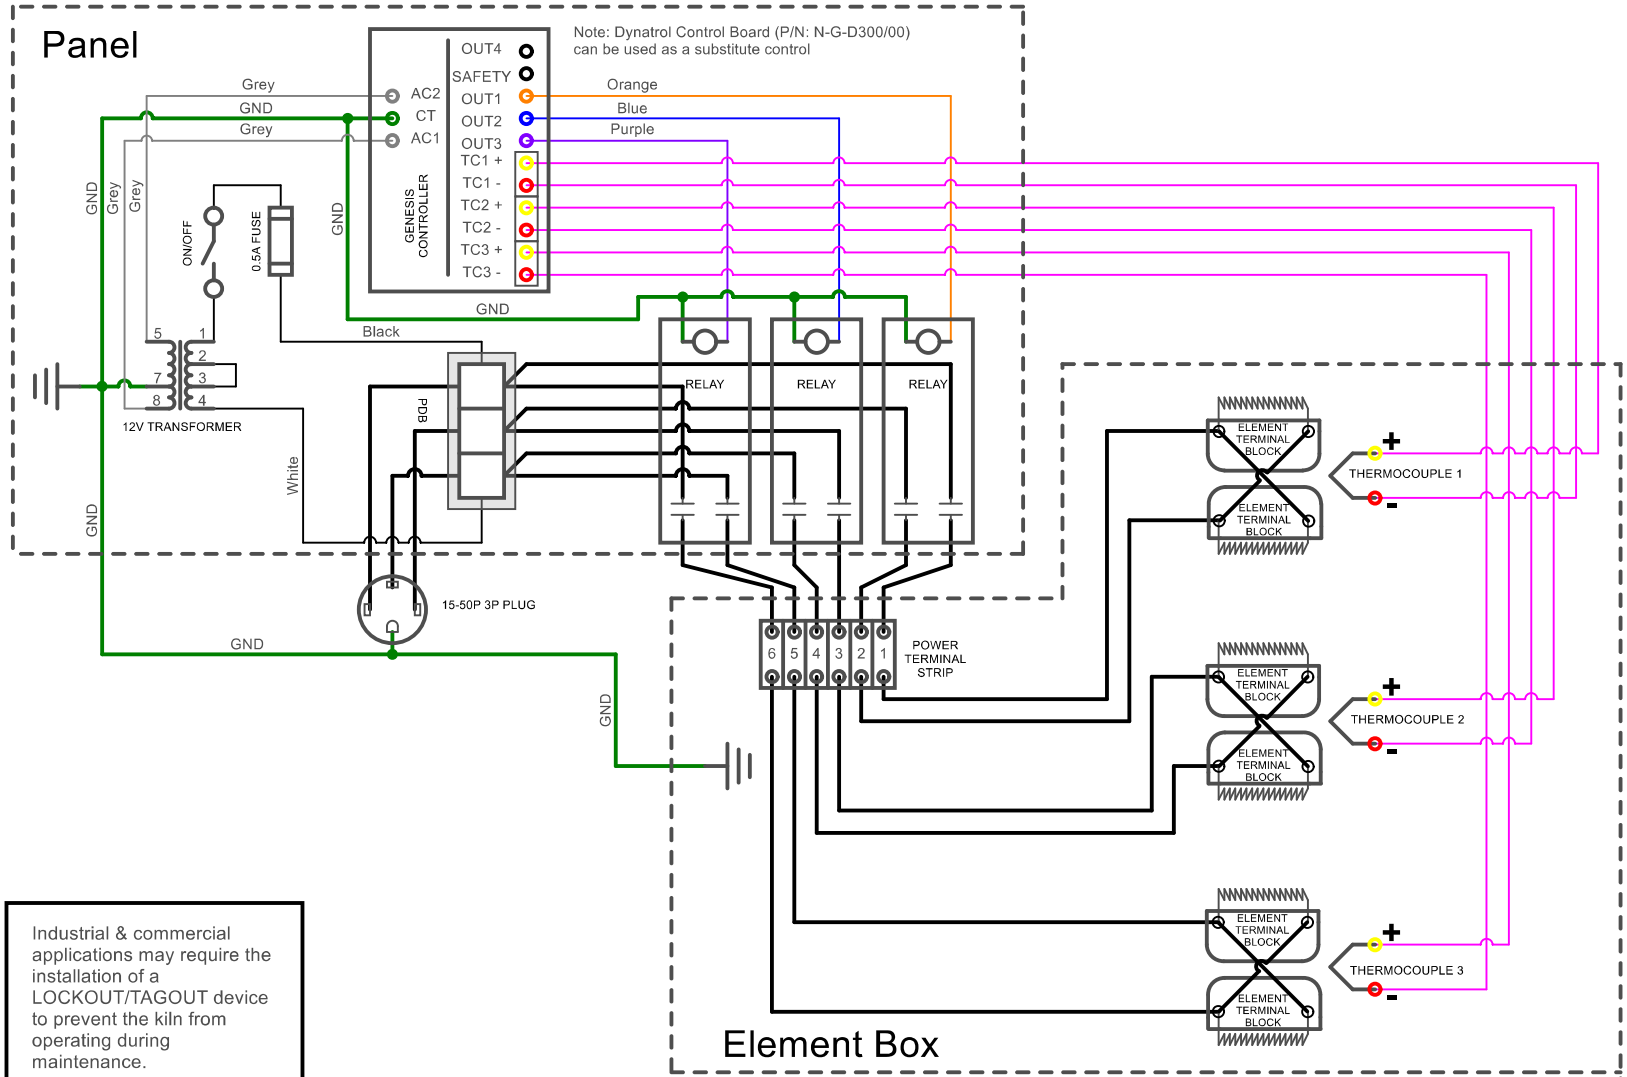

Industrial & commercial applications may require the installation of a LOCKOUT/TAGOUT device to prevent the kiln from operating during maintenance.

This kiln is recommended to be wired & connected to an approved U. L. & NEC configured receptacle controlled with a disconnect switch and properly fused according to the kW load specification listed on the kiln nameplate. L&L Kiln Mfg., Inc., also recommends fuses rather than circuit breakers to prevent nuisance tripping.

Wiring Information	
Power	10AWG / 150°C / 600V
Control	16-22AWG / 105°C / 600V
Power Supply Wire Gauge assumes 75°C Copper Wire. See hotkilns.com/wire-size.	

Model: e23T-208-3P	
Voltage	208 / 3 / 50-60
Watts	11,000
Full Load Amps	L1 L2 L3 30.5 30.5 30.5
Power Supply	Fuse Wire 40A 8AWG
Standard Elements: E-E-23TL/22 Quad Elements: E-E-23TU/22	
Quantity: 6	Ohms: 22.7

Model: e23T-240-3P	
Voltage	240 / 3 / 50-60
Watts	11,520
Full Load Amps	L1 L2 L3 27.7 27.7 27.7
Power Supply	Fuse Wire 40A 10AWG
Standard Elements: E-E-23TL/31 Quad Elements: E-E-23TQ/31	
Quantity: 6	Ohms: 28.9

E23T Easy-Fire 3 Phase 208V, 240V			 505 Sharptown Road Swedesboro NJ 08085 service@hotkilns.com (856)-294-0077 Drawn by: JS C0026
Rev.	Date	Description	