


0100
0101
0102
0103
0104
0105
0106
0107
0108
0109
0110
0111
0112
0113
0114
0115
0116
0117
0118
0119
0120
0121
0122
0123
0124
0125
0126
0127
0128
0129
0130
0131
0132
0133

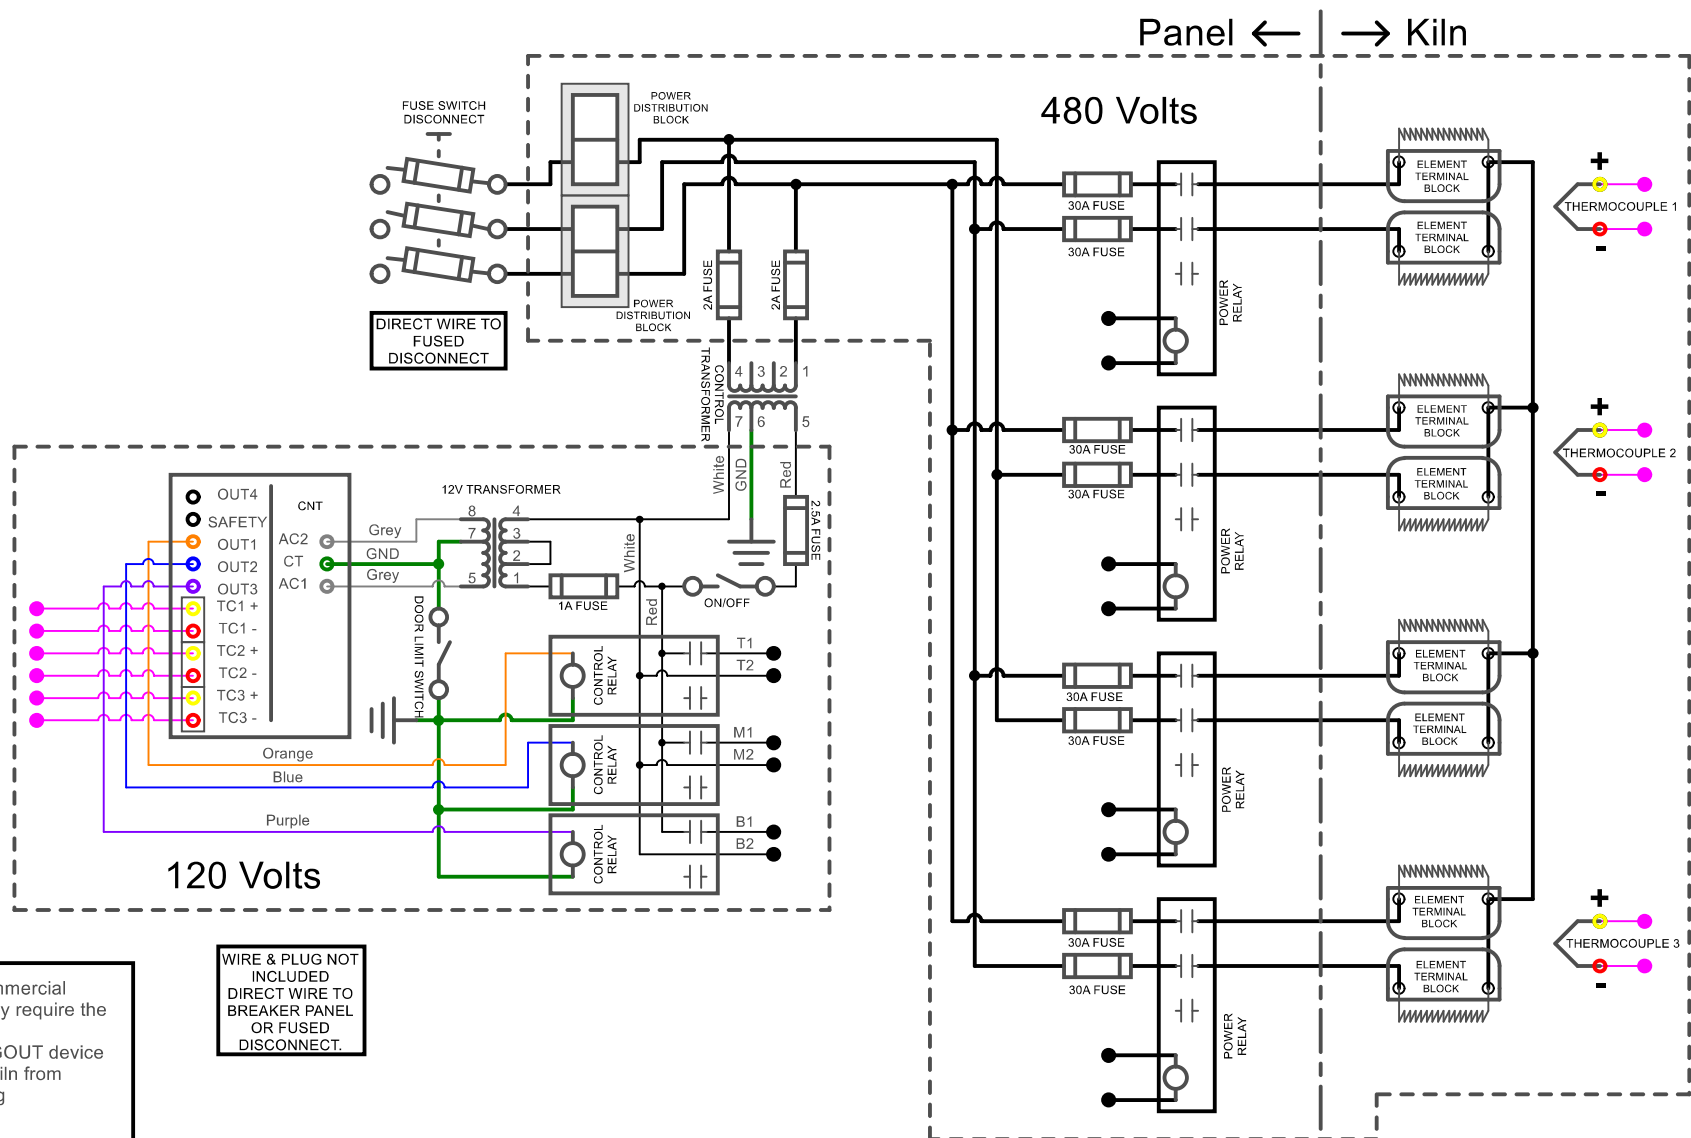

Industrial & commercial applications may require the installation of a **LOCKOUT/TAGOUT** device to prevent the kiln from operating during maintenance.

This kiln is recommended to be wired & connected to an approved U. L. & NEC configured receptacle controlled with a disconnect switch and properly fused according to the kW load specification listed on the kiln nameplate. L&L Kiln Mfg., Inc., also recommends fuses rather than circuit breakers to prevent nuisance tripping.

Model: eFL2635-480-3P			
Voltage	480 / 3 / 50-60		
Watts	19,200		
Full Load Amps	L1	L2	L3
	26.0	26.0	17.3
Power Supply	Fuse		Wire
	40A		10AWG
Elements E-H-2635/60	QTY		OHMS
	8		30.8

eFL2635 3 Phase 480V 480V			
			505 Sharptown Road Swedesboro NJ 08085 service@hotkilns.com (856)-294-0077
			Drawn by: JS
Rev.	Date	Description	C0083