

Industrial & commercial applications may require the installation of a LOCKOUT/TAGOUT device to prevent the kiln from operating during maintenance.


This kiln is recommended to be wired & connected to an approved U. L. & NEC configured receptacle controlled with a disconnect switch and properly fused according to the kW load specification listed on the kiln nameplate. L&L Kiln Mfg., Inc., also recommends fuses rather than circuit breakers to prevent nuisance tripping.

Wiring Information

Power 14AWG / 150°C / 600V

Control 16-22AWG / 105°C / 600V

Power Supply Wire Gauge assumes 75°C Copper Wire. See hotkilns.com/wire-size.

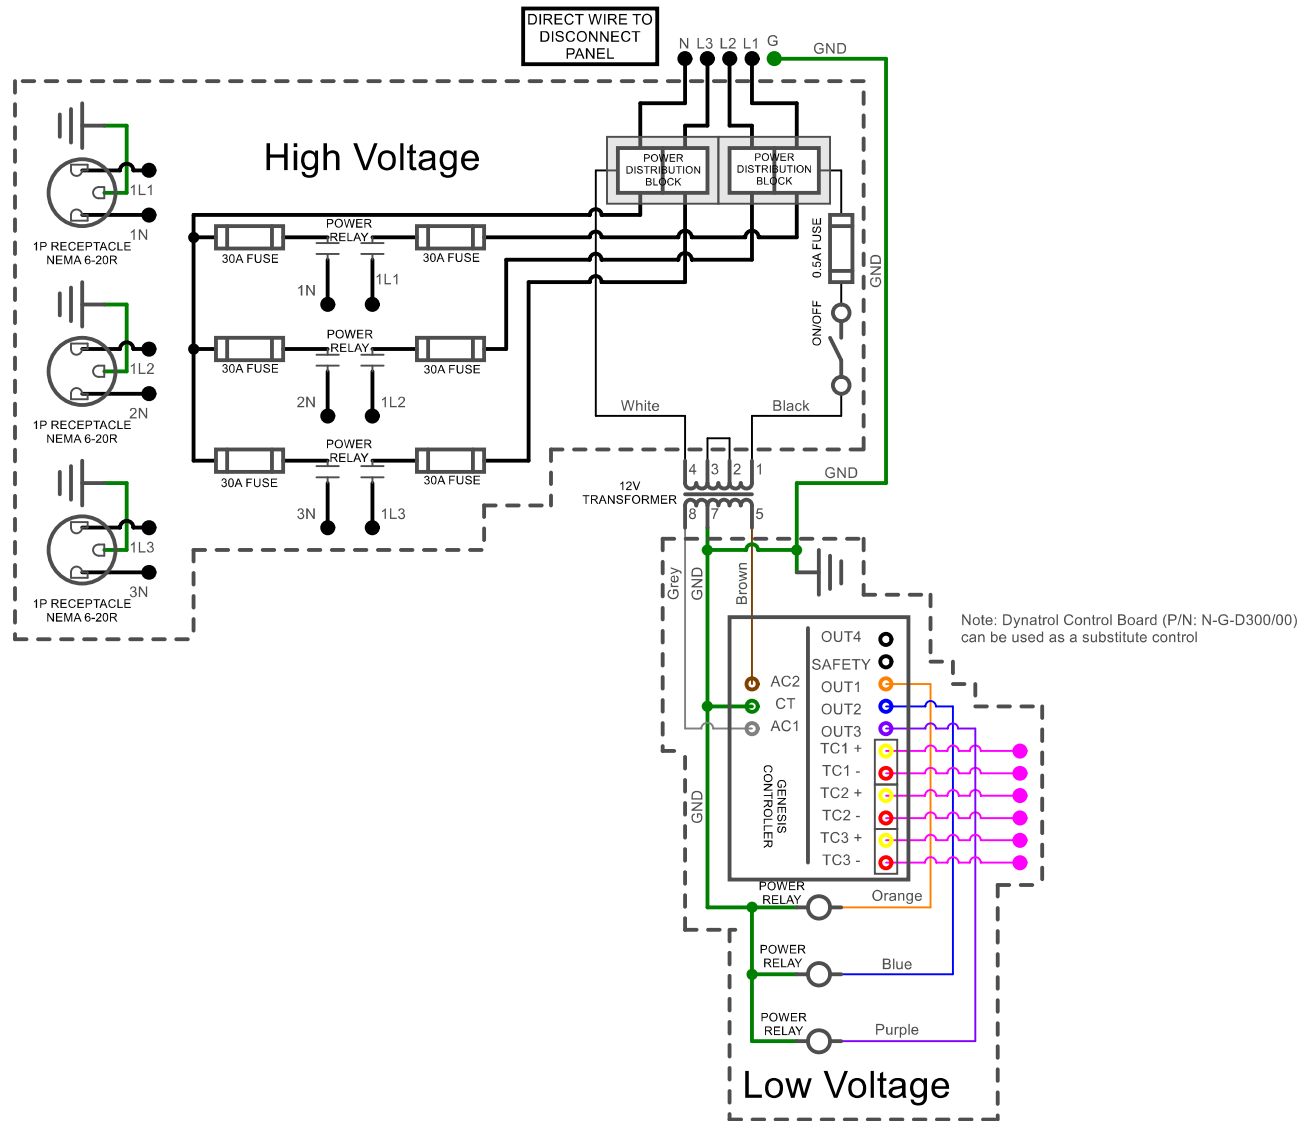

JD230-EZ 3 Phase Wye



505 Sharptown Road
Swedesboro NJ 08085
service@hotkilns.com
(856)-294-0077

Drawn by: JS

P0007