


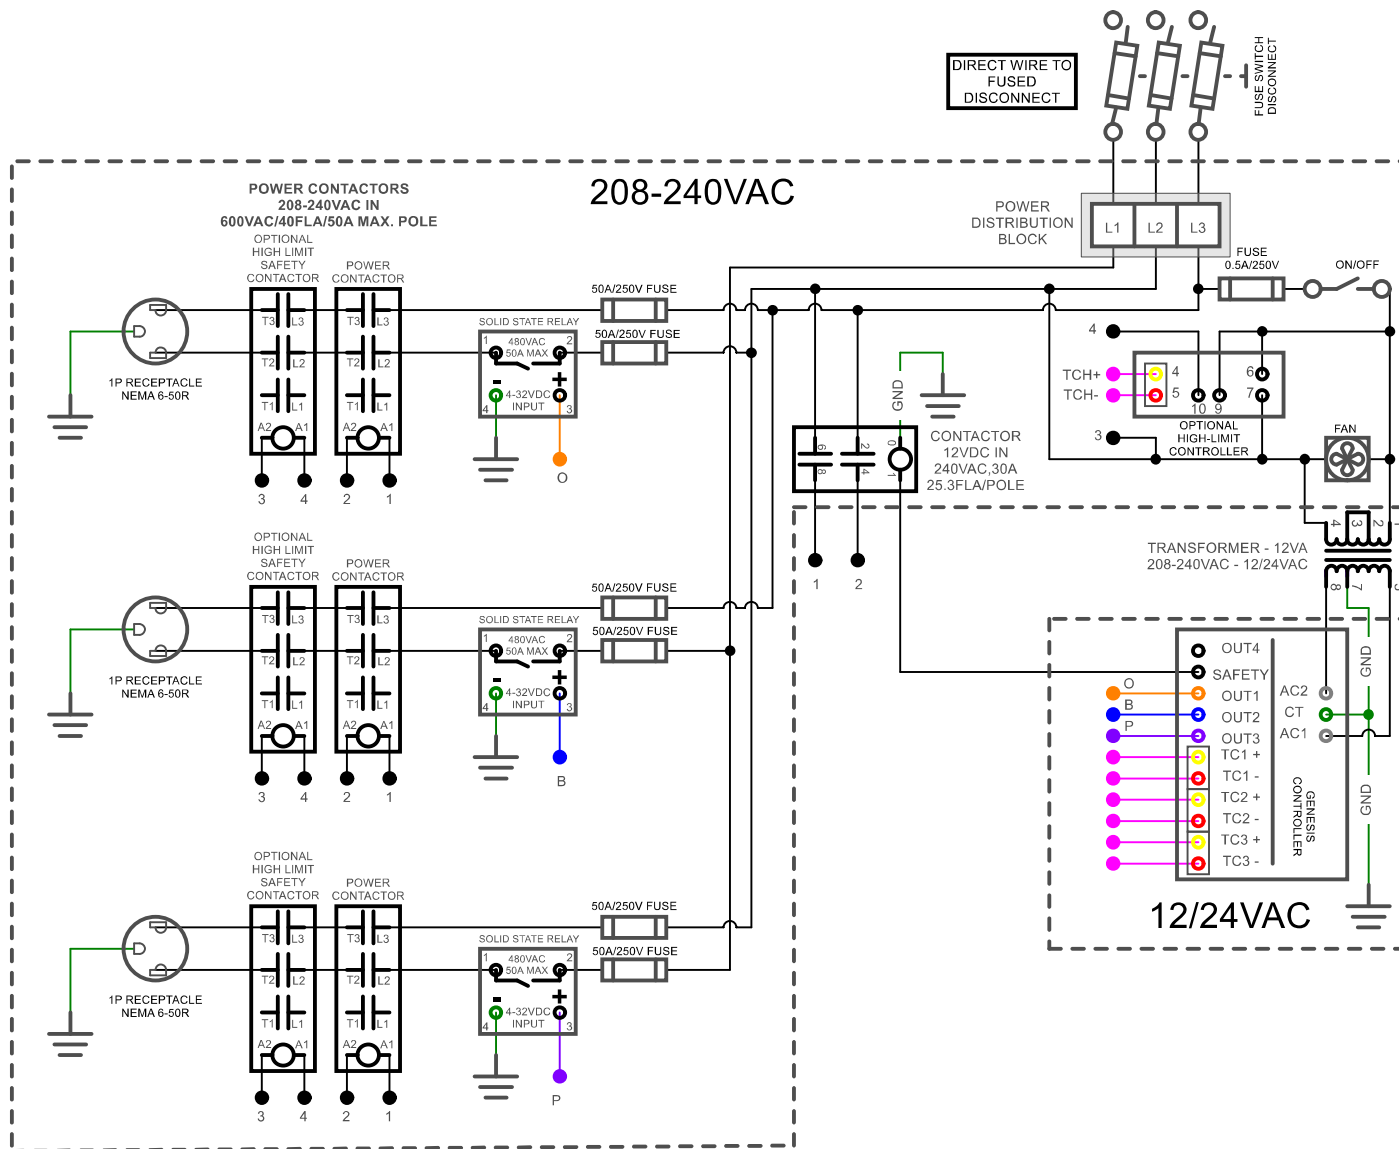

Industrial & commercial applications may require the installation of a LOCKOUT/TAGOUT device to prevent the kiln from operating during maintenance.

This kiln is recommended to be wired & connected to an approved U. L. & NEC configured receptacle controlled with a disconnect switch and properly fused according to the kW load specification listed on the kiln nameplate. L&L Kiln Mfg., Inc., also recommends fuses rather than circuit breakers to prevent nuisance tripping.

WIRE GAUGES

Power	10AWG / 150°C / 600V
Control	16-22AWG / 105°C / 600V
Power Supply Wire Gauge assumes 75°C Copper Wire. See hotkilns.com/wire-size .	

T3427, 208-240V, 3 PHASE (P0035)



505 Sharptown Road
Swedesboro NJ 08085
service@hotkilns.com
(856)-294-0077

Rev.	Date	Description	Approved by	Dwg. No.
B	06/16/2026	TEMPLATE UPDATED	AF	DL
A	02/04/2026		AF	DL
				Drawn by: AF
				Dwg. No. P0035