

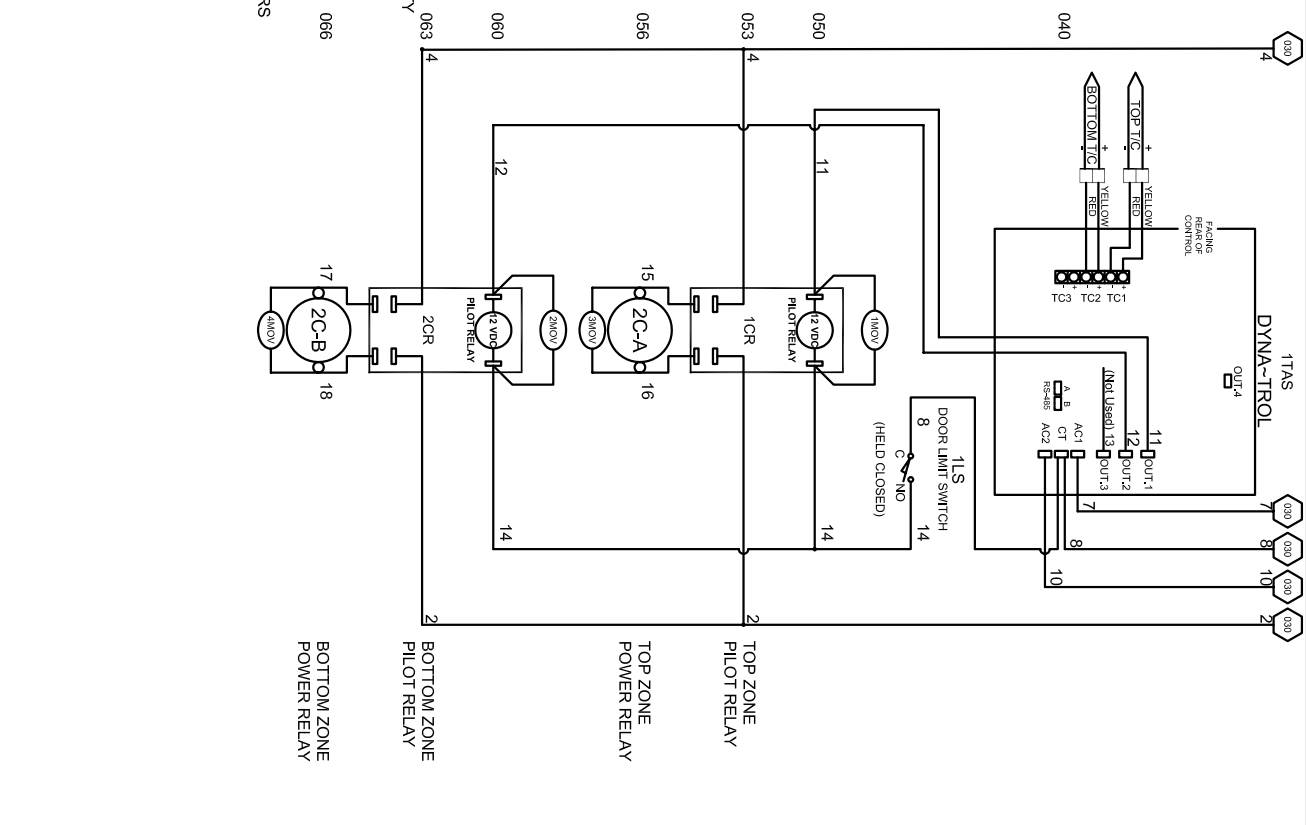
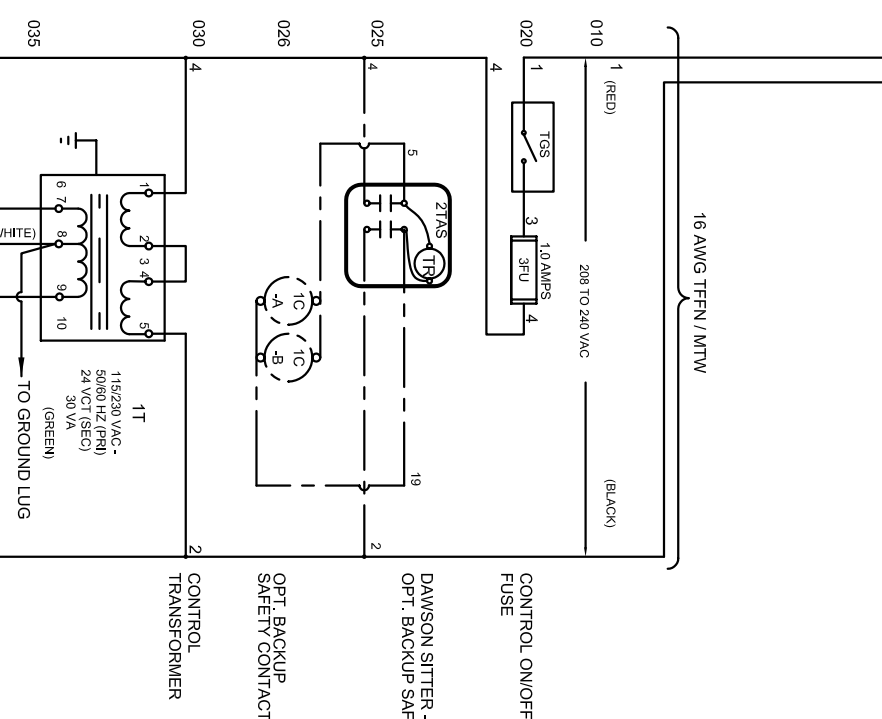


SAFETY SWITCH BY CUSTOMER
 Connect to 208 Volt, 1 Phase
 50 or 60 Cycles.
 SEE POWER REQUIREMENT TABLE

POWER REQUIREMENTS			
VOLTAGE	208 / 1 / 60		
KW	10.5		
H.P.	N/A		
FULL LOAD AMPS	L1	L2	L3
	51	51	1 ~

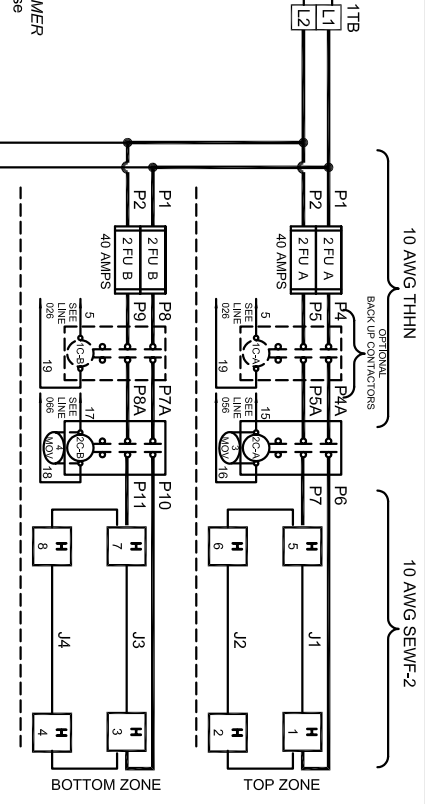

REV.#	DATE	REVISION DESCRIPTION
0		ISSUE FOR CONSTRUCTION
1		ISSUE FOR CONSTRUCTION
2		ISSUE FOR CONSTRUCTION
3		ISSUE FOR CONSTRUCTION
4		ISSUE FOR CONSTRUCTION
5		ISSUE FOR CONSTRUCTION
6		ISSUE FOR CONSTRUCTION
7		ISSUE FOR CONSTRUCTION
8		ISSUE FOR CONSTRUCTION
9		ISSUE FOR CONSTRUCTION
10		ISSUE FOR CONSTRUCTION

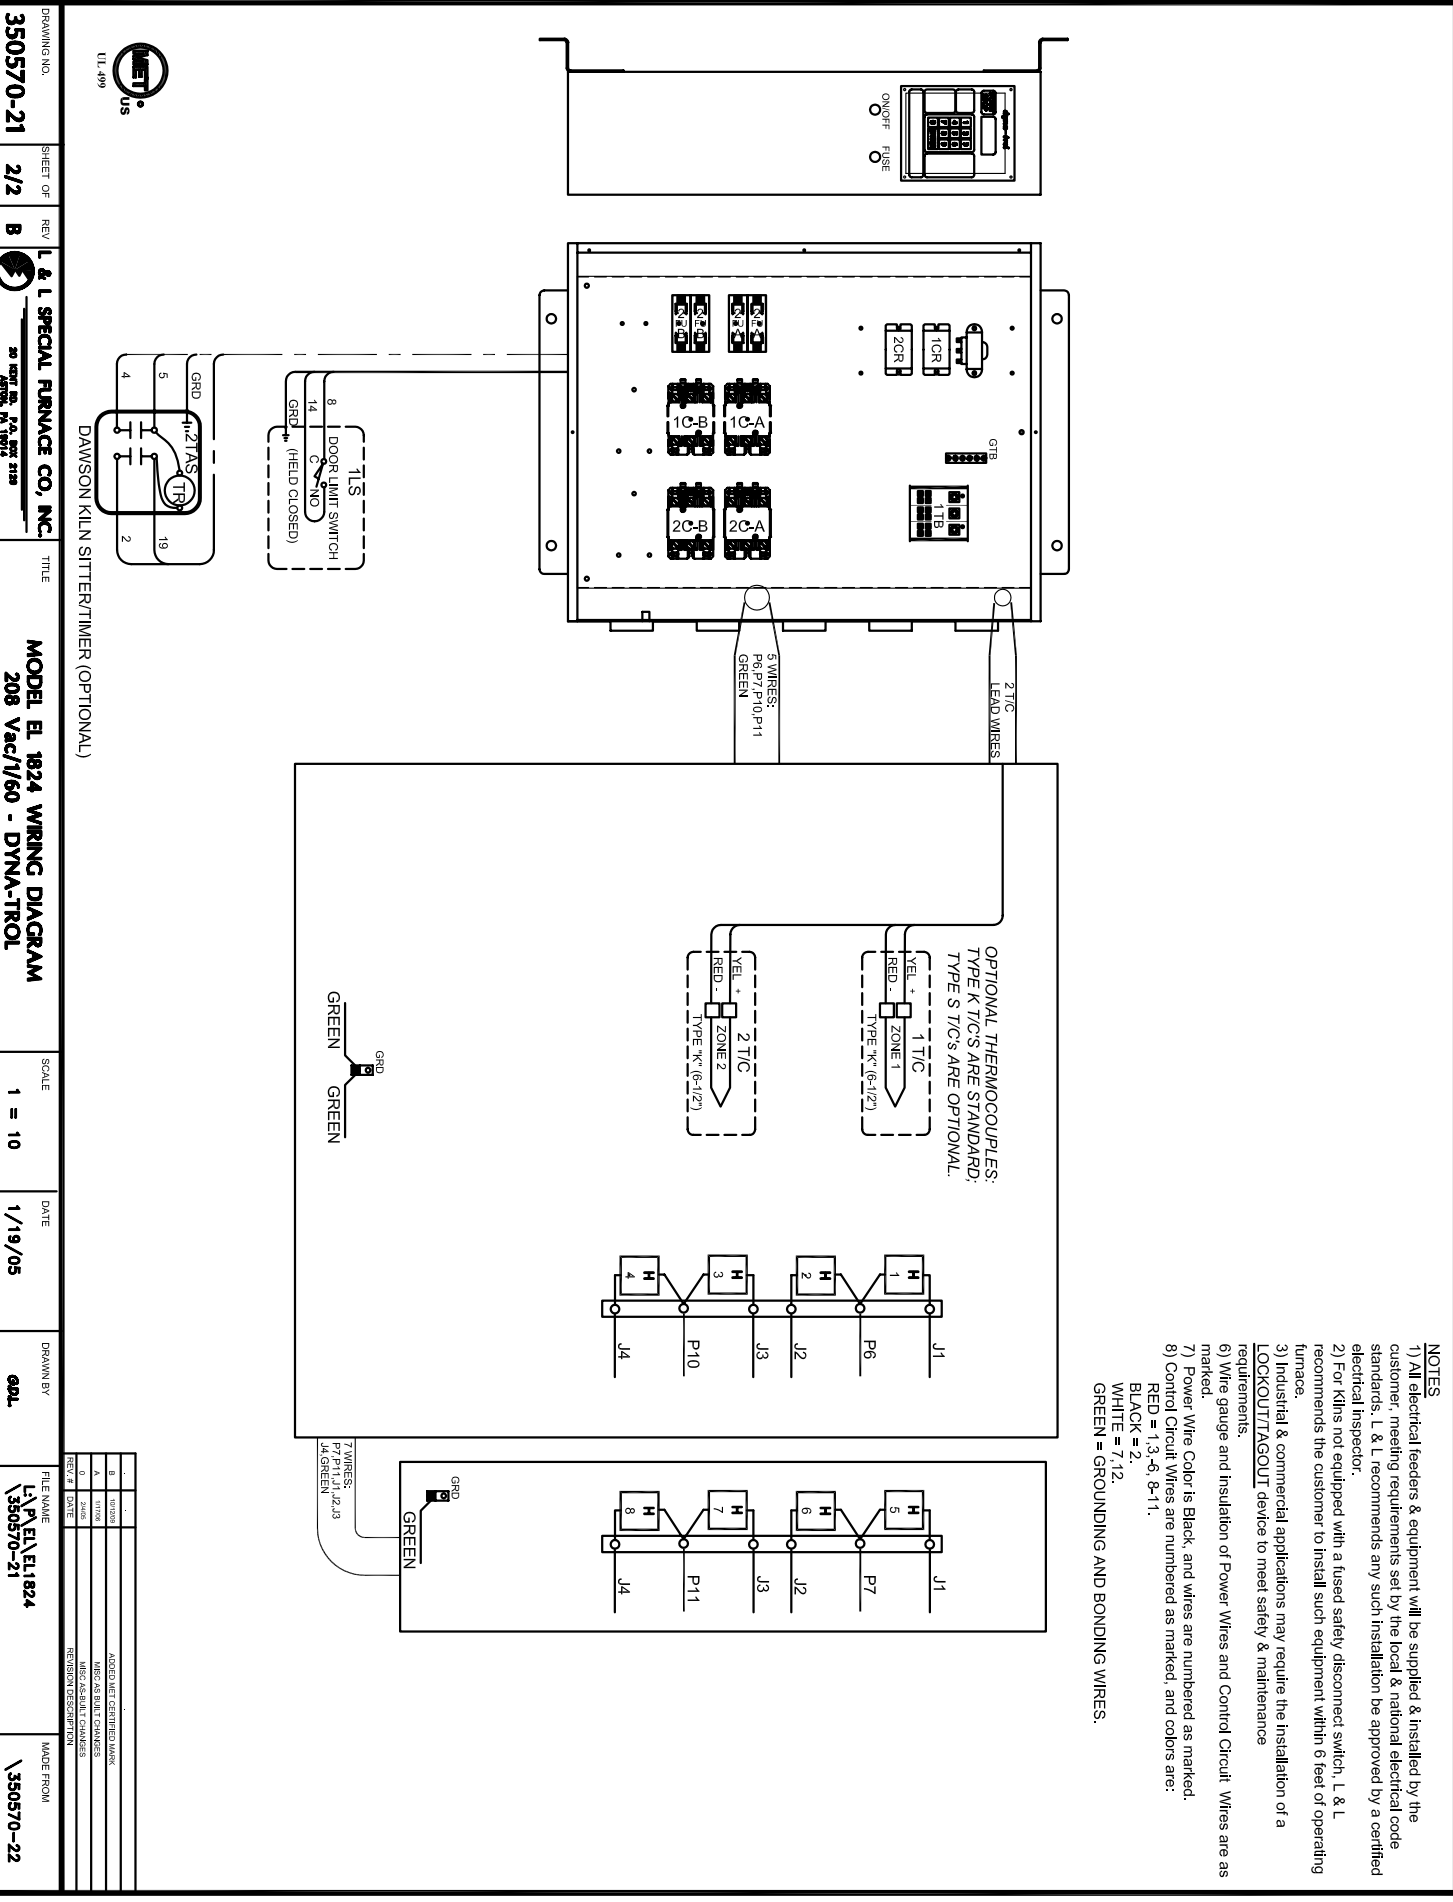

- NOTES**
- 1) All electrical feeders & equipment will be supplied & installed by the customer. Meeting requirements set by the local & national electrical code standards. L & L recommends any such installation be approved by a certified electrical inspector.
 - 2) For kilns not equipped with a fused safety disconnect switch, L & L recommends the customer to install such equipment within 6 feet of operating furnace.
 - 3) Industrial & commercial applications may require the installation of a LOCKOUT/TAGOUT device to meet safety & maintenance requirements.
 - 6) Wire gauge and insulation of Power Wires and Control Circuit Wires are as marked.
 - 7) Power Wire Color is Black, and wires are numbered as marked.
 - 8) Control Circuit Wires are numbered as marked, and colors are:
 RED = 1, 3, 6, 8-11.
 BLACK = 2.
 WHITE = 7, 12.
 GREEN = GROUNDING AND BONDING WIRES.

DRAWING NO.	SHEET OF	REV.	TITLE	SCALE	DATE	DRAWN BY	FILE NAME	MADE FROM
350570-21	2/2	B	L & L SPECIAL FURNACE CO. INC. 20 WEST 10TH ST. WYOMING ALLEN, WY 83418	1 = 10	1/19/05	GDJ	L:\P\EL\EL1824\350570-21	\350570-22



UL 499

DAWSON KILN SITTER/TIMER (OPTIONAL)

REV. #	DATE	REVISION DESCRIPTION
1		ISSUED
2		REVISED
3		REVISED
4		REVISED
5		REVISED
6		REVISED
7		REVISED
8		REVISED
9		REVISED
10		REVISED

APPROVED FOR CONSTRUCTION
 MISC. AS BUILT CHANGES
 MISC. AS BUILT CHANGES
 MISC. AS BUILT CHANGES

APPROVED FOR CONSTRUCTION
 MISC. AS BUILT CHANGES
 MISC. AS BUILT CHANGES
 MISC. AS BUILT CHANGES

APPROVED FOR CONSTRUCTION
 MISC. AS BUILT CHANGES
 MISC. AS BUILT CHANGES
 MISC. AS BUILT CHANGES

APPROVED FOR CONSTRUCTION
 MISC. AS BUILT CHANGES
 MISC. AS BUILT CHANGES
 MISC. AS BUILT CHANGES